
Project Number: NZ0074823.8474

Hydrological Modelling Dataset

Report 1: Infrastructure and hydro constraint attributes

28th September 2026

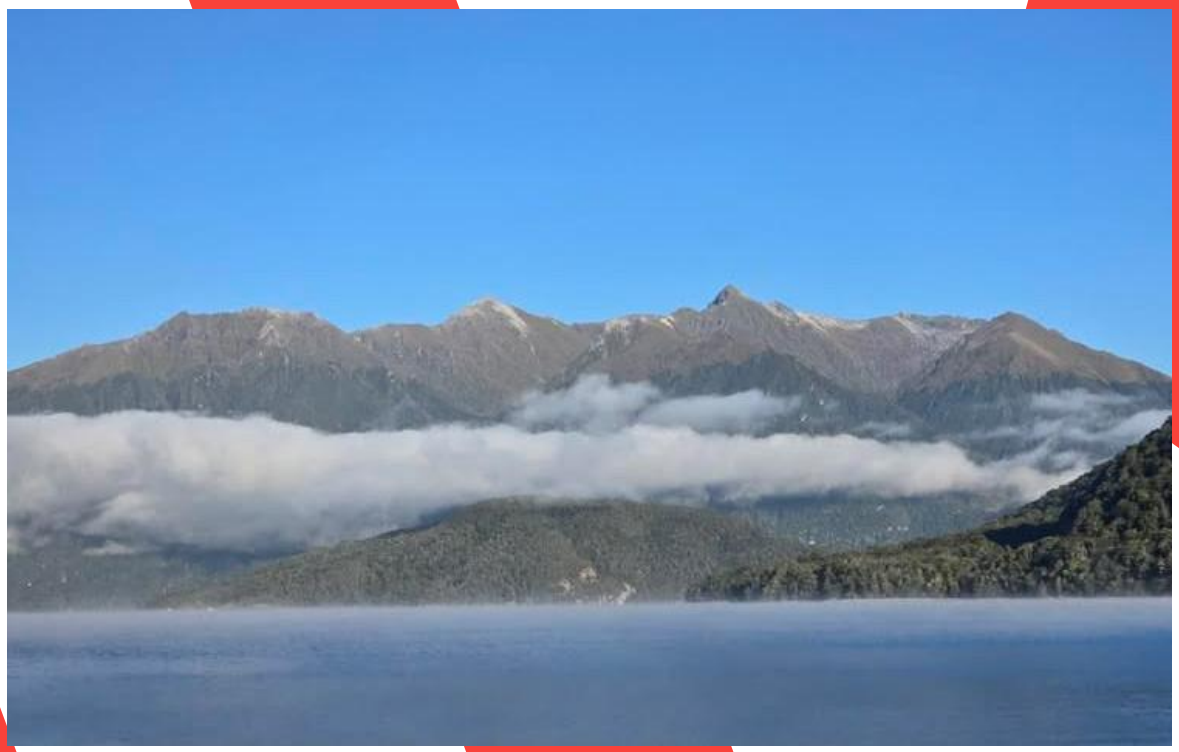

Hydrological Modelling Dataset

Report 1: Infrastructure and hydro constraint attributes

WSP
Christchurch
12 Moorhouse Avenue
Christchurch 8011
New Zealand
+64 3 363 5400
wsp.com/nz

REV	DATE	DETAILS
WSP – 1	28 September 2026	Final Report to Client

	NAME	DATE
Original content by:	Matthew Keir, Electricity Authority	Version 1.3 updated 27 July 2021
Formatting reviewed by:	Deborah Maxwell (SLR)	28th September 2026
Approved by:	Dave Maslin (WSP)	28th September 2026

Cover image: Lake Hauroko (Lizzie Fox, 2020).

Disclaimers and Limitations

This report ('Report') has been prepared by WSP exclusively for Electricity Authority ('Client') in relation to the hydrological modelling dataset (HMD) full update 2024 ('Purpose') and in accordance with AoG Consultancy Services Order dated 14 April 2026. The findings in this Report are based on and are subject to the assumptions specified in the Report and Offer of Services dated 14 April 2026. WSP accepts no liability whatsoever for any reliance on or use of this Report, in whole or in part, for any use or purpose other than the Purpose or any use or reliance on the Report by any third party.

In preparing the Report, WSP has relied upon data and other information ('Client Data') provided by or on behalf of the Client. Except as otherwise stated in the Report, WSP has not verified the accuracy or completeness of the Client Data. To the extent that the statements, opinions, facts, information, conclusions and/or recommendations in this Report are based in whole or part on the Client Data, those conclusions are contingent upon the accuracy and completeness of the Client Data. WSP will not be liable in relation to incorrect conclusions or findings in the Report should any Client Data be incorrect or have been concealed, withheld, misrepresented, or otherwise not fully disclosed to WSP.

PREFACE

A large proportion of New Zealand's electricity needs are met by generation from hydro power. Information about the distribution of inflows and the capability of the various hydro systems is necessary to ensure a reliable, competitive, and efficient market and electricity system.

The hydrological modelling dataset (HMD) is a dataset of hydrological information made available by the Electricity Authority. The dataset was known as the SPECTRA update until 2010. In 2015 the dataset was revised to become the HMD, a comprehensive dataset that can be relied upon by modellers and analysts to test scenarios, provide commentary and inform decisions.

The HMD is comprised of data provided by hydro generators and supplemented with data from other sources. These parties are acknowledged for their contribution and for making this data available.

The HMD consists of three main components:

1. **Infrastructure and hydrological constraint attributes:**
    - This dataset records standing information about the capability of the main hydro schemes.
2. **Flows:**
    - This time series dataset records data for inflows for reservoirs and flows at various existing or potential hydro generating sites.
3. **Storage and spill:**
    - This time series dataset records storage for the main hydro schemes.

This information paper describes the first component of the HMD, the infrastructure and hydro constraints.

TABLE OF CONTENTS

PREFACE III

1 INFRASTRUCTURE AND HYDRO CONSTRAINTS ATTRIBUTES 1

2 INFRASTRUCTURE ATTRIBUTES 1

3 HYDROLOGICAL CONSTRAINTS 1

3.1 STORAGE CONSTRAINTS 1

3.2 FLOW CONSTRAINTS 2

4 SUMMARY OF INFRASTRUCTURE AND HYDRO CONSTRAINT FIELDS 2

5 RANKING METHOD 4

6 MAINTAINING THIS DATASET 5

1 INFRASTRUCTURE AND HYDRO CONSTRAINT ATTRIBUTES

Infrastructure and hydrological constraints together define the capability of hydro generating schemes to store energy and produce electricity. This dataset records material attributes of generating plant and consents that govern storage volumes and flows associated with the main reservoirs from 1980 onwards.

The information has been collected from plant owners and consenting agencies. It is needed to accurately derive the specific energy (in terms of electricity potential) of water in each reservoir and energy storage in GWh.

The dataset tracks changes in these attributes through time providing a record of plant and hydro scheme capability. Understanding historical capability is useful – especially when undertaking analysis based on historical outcomes.

2 INFRASTRUCTURE ATTRIBUTES

Infrastructure attributes are those defined primarily by the engineering aspects of a hydro generating station. The dataset captures both the capacity of the station and a plant factor that defines the relationship between flow and energy production. Table 4.1 describes the fields in the dataset.

Any infrastructure changes that alter either the plant factor or the capacity should be captured by the owner or station operator and passed on to either the system operator or the Electricity Authority (Authority). Examples could be re-runnering the hydro units, extending the capacity of the units by rewinding the generators, or even changing the operating regime of the reservoir to increase the average head during operation of the station.

Nominally, plant factors recorded are intended to represent an average factor over the last three years, unless an obvious intervention to the plant has taken place.

3 HYDROLOGICAL CONSTRAINTS

Hydrological constraints apply only to **reservoir** or **hydro arc** plant types, and place restrictions on storage or flows. The list of hydro arcs is not exhaustive. Additionally, hydro nodes or junctions are not captured in the dataset. Modellers will have to take some additional details into account in their models.

3.1 STORAGE CONSTRAINTS

This dataset records the capacity of reservoirs to store water. Reservoirs generally have standard operating ranges defined by consents (or engineering features). In some cases consents vary by time (e.g. month or season). In addition, reservoirs can have contingent storage that becomes available when certain conditions are met. This additional storage has a material impact on the system, participant behaviours, and when assessing shortage risk or monitoring security of supply.

Some controls or restrictions on reservoirs can be complex and this dataset does not attempt to capture all these nuances – especially around flood control or management.

There are four types of storage that are represented in this dataset:

a. Active storage capacity

    i. Operational storage able to be used in the normal operation of the system by the scheme or plant operator. This storage may have seasonal consents, increasing the active storage capacity at certain times of the year.

ii A seasonal consent that lowers the allowable operating minimum will immediately make additional stored water available (i.e. increase active storage available to the generator). Conversely, a seasonal consent that raises the operating maximum will increase the active storage capacity available to be utilised by the generator but clearly won't make more stored water available.

b Consented contingent storage capacity

i Additional storage capacity available below the active storage range of a reservoir which becomes available to the generator when certain conditions are met. As this storage capacity is below the active storage it provides access to additional stored water or energy. Consented contingent storage and its associated conditions are defined in a consent or similar document.

c Available contingent storage capacity

i Recognises that although an operator may have consent to draw down reservoir levels and use storage, there may be other engineering-based or practical limitations that constrain the use of the storage. In terms of security of supply, this is the best measure of additional storage that will practicably become available when the relevant triggers are met.

d Active contingent storage capacity

i Records when consent conditions are met to trigger the available contingent storage capacity. The capacity and dates within the dataset are adjusted accordingly. The triggering and use of active contingent storage is recorded in the third part of this dataset. Normally active contingent storage will be recorded as zero.

3.2 FLOW CONSTRAINTS

Hydro systems can be complex and there are often multiple paths that water can take in a scheme. We've called these paths **hydro arcs**. Each of these hydro arcs can have a constraint that limits the operation of the hydro scheme in some way. The HMD captures the material restrictions to flow within the schemes enabling modellers to better approximate the true capability of the system.

4 SUMMARY OF INFRASTRUCTURE AND HYDRO CONSTRAINT FIELDS

Table 4.1 records a summary and description of the fields in the dataset.

Table 4.1: Infrastructure and hydro constraint attributes

Field Name	Format	Description
Plant Group	Text	Describes the hydro scheme that the plant is part of.
Island	2 char code	North Island (NI) or South Island (SI).
Site	3 char code	Provides a site code that links the individual station or asset to the wholesale market data. Some new codes have been introduced for hydrological sites that are not used within the market systems such as pricing or reconciliation.
Plant group rank	numeric	Rank applies a relative order for each asset or feature in the group or scheme. NZ hydro chains are linear (for generation) so this simple linear ranking methodology holds true. We use the first digit to rank **reservoirs** by the specific energy of the water within them – plant group.

Field Name	Format	Description
		Rank 1 has the highest energy per cubic meter of water within the scheme. Reservoirs of equal rank are in the same stage in the hydro scheme. The first decimal value ranks **hydro** generating stations fed directly from the reservoir (without going through another reservoir). The second decimal value records **hydro arcs** or flow paths in their relative order from the reservoir. In all cases, equal ranking indicates parallel **hydro arcs**, **hydro** plant or **reservoirs** where storage has equivalent specific energy to the scheme. Sequential ranking indicates series flow. For example: 1.01 and 1.11 would be parallel **hydro arcs** from the first **reservoir** in the scheme. 1.01 refers to flow leaving the reservoir without going through a generator. 1.11 refers to the flow through the **hydro** station. We do not record information for all flow arcs in the hydro scheme – only those that have material impact on the operation of the scheme. See the schematic in Figure 5-1.
Plant type	text	Plant types are: • **Reservoir** • **Hydro** • **Hydro arc**
Sub type	text	Further breakdown of plant type. **Reservoirs** are either: • Controlled • Run of river **Hydro** plant is recorded as hydro and not broken down into the various types of turbine technology (Francis or Kaplan etc.). **Hydro arcs** are one of: • River • Canal • Station flow • Spill
Description	text	A description of the reservoir, hydro plant or hydro arc.
Attribute	text	**Reservoir** plant types have attributes of: • Active storage capacity (million cubic meters or Mm^3) • Consented contingent storage capacity ($Mm^{3)}$ • Available contingent storage capacity (Mm^3) • Active contingent storage capacity (Mm^3) See section 3.1 for a description of these types. **Hydro** plant has attributes of: • Plant factor – nominally a three-year average (cumecs/MW) • Generating capacity (MW) **Hydro arc** plant types have attributes of: • Max flow (cumecs)[1] • Min flow (cumecs) • Min monthly volume (Mm^3)

[1] A cumec is a flow rate measures as a cubic meter per second.

Field Name	Format	Description
		In the case of spill flow (a type of **hydro arc**), we identify the specific mechanism where it is known (e.g. max spill/siphon/sluice flow).
Value	numeric	Records the numeric value or quantity for the attribute. Null should be read as there is no limit for this attribute. A null value does not mean that there is not another constraint restricting the attribute value.
Unit	text	The unit for the numeric value of the related attribute.
Start date	dd-mm-yyyy	Date in ISO format for when an attribute, value, schedule, source or consent begins to apply. For example, when infrastructure was modified or upgraded, a consent was renewed or amended, or available contingent storage capacity is triggered (i.e. becomes active contingent storage capacity).
End date	dd-mm-yyyy	Date in ISO format for when an attribute, value, schedule, source or consent ceases to apply.
Schedule	cron expression	Schedules apply only to hydrological constraints; either **reservoir** storage volumes (with a seasonal consent) or flow in **hydro arcs**. They make use of standard cron style expressions. Cron expressions are made of up to six fields that combine to represent a set of time spans. • Minute (0-59) • Hour (0-23) • Day of month (1-31) • Month (1-12) • Day of the week (0-6, where Sunday=0) • Year (0001-9999) Each field can include either; (a) an asterisk that covers the full allowable range, (b) an individual value, (c) a range of values, or (d) a list of both values and/or ranges. Fields are separated by spaces, lists by commas, and ranges are denoted by a hyphen. For example, a schedule that applies to office hours over summer (i.e., Mon-Fri, 9am-5pm, Oct-Mar), would appear as: *** 9-17 * 1-3,10-12 1-5 *** For more information see: https://en.wikipedia.org/wiki/Cron#CRON_expression
Source	text	The entity that provided the information.
Consent	alphanumeric	The relevant consent or document number.
Notes	text	Additional notes describing relevant contextual information. For example lake levels (that define the volume), a trigger condition for contingent storage, or a consenting body for a hydro constraint

5 RANKING METHOD

Reservoirs, hydro plant and hydro arcs in each hydro system are ranked; providing information on their relationship and dependence on each other in a simple numeric format. However, this information does not provide complete information on all nodes (start and end points) or hydro arcs. Users of the dataset will need additional information or knowledge to fully develop accurate flow system models. Figure 5-1 illustrates the linear ranking method adopted in the dataset

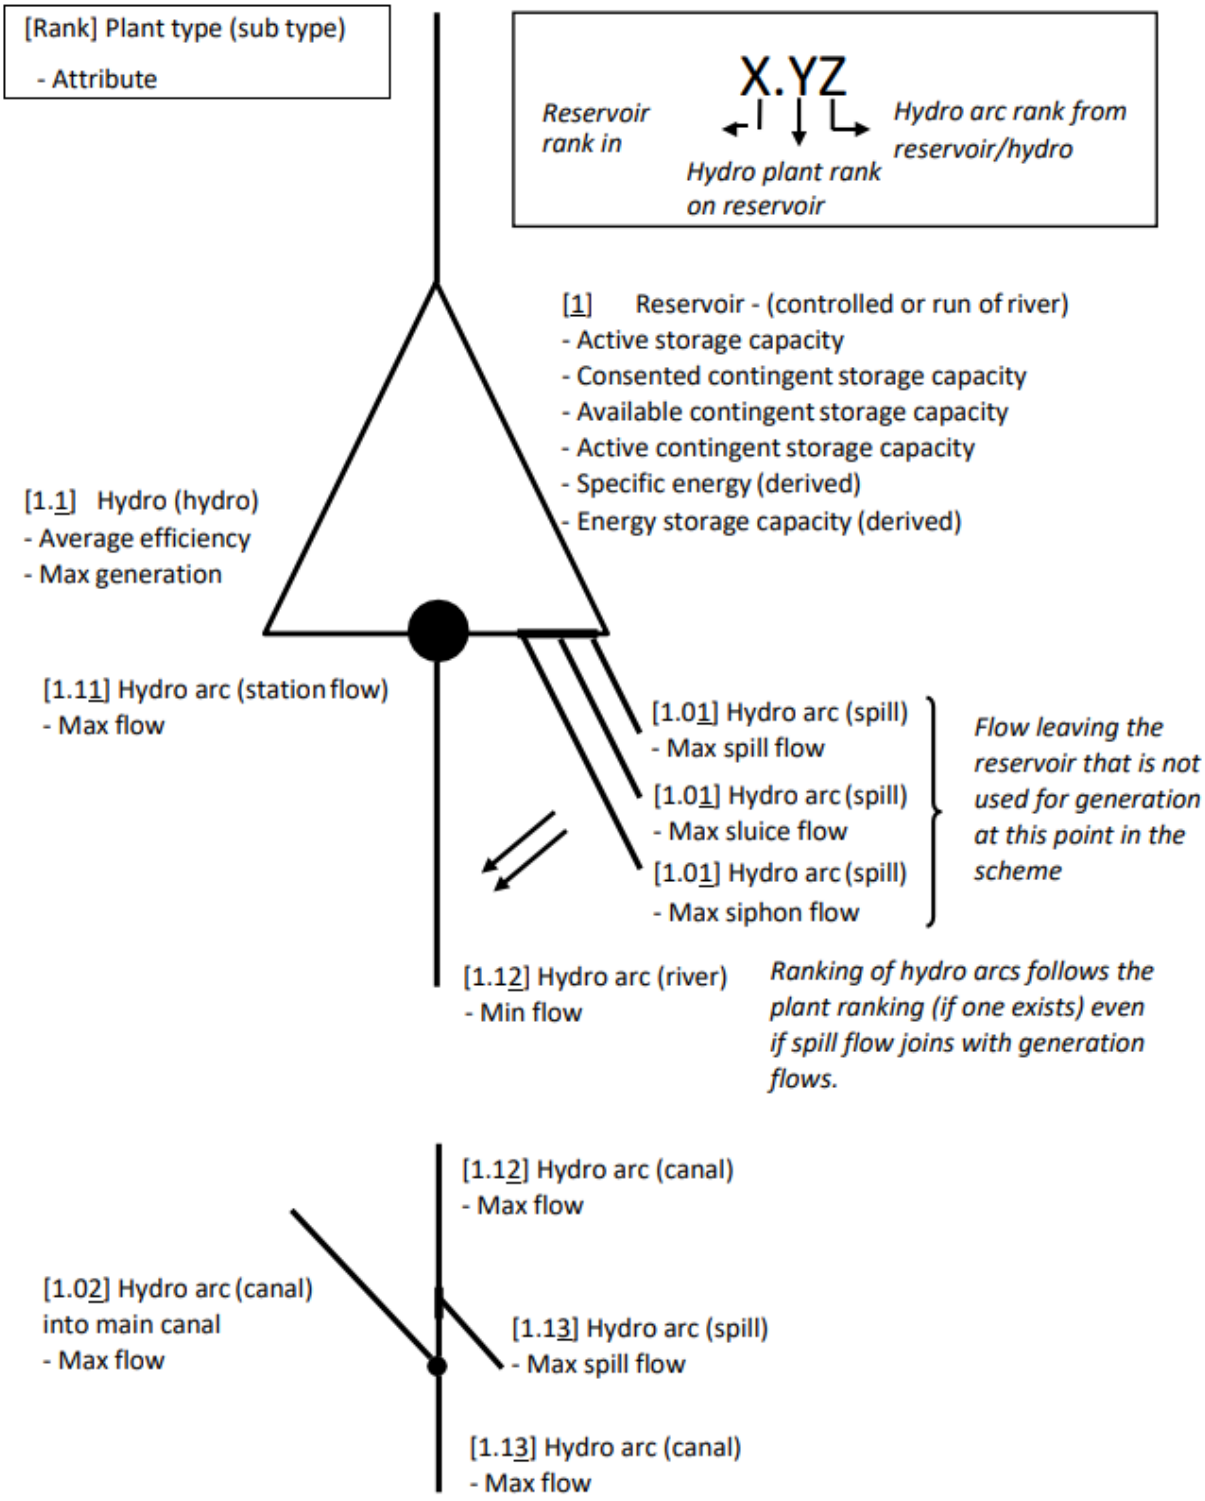


Figure 5-1: Ranking within hydro schemes.

6 MAINTAINING THIS DATASET

The infrastructure and hydrological constraints dataset will be maintained as changes occur. If the infrastructure capability or consent conditions change, please let either the Authority know by contacting **emi@ea.govt.nz**, or the system operator through their consultations or discussions on security of supply.